

1. Package Contents

Thank you for purchasing PLANET Industrial Multi-port 10/100/1000T Gigabit Ethernet Switch, IGS-1600T/IGS-1820TF. In the following sections, the term “**Industrial Ethernet Switch**” means the IGS-1600T or IGS-1820TF.

Open the box of the Industrial Ethernet Switch and carefully unpack it. The box should contain the following items:

Industrial Ethernet Switch x 1 	User's Manual x 1 	RJ45 Dust Cap x 16 
DIN-rail Kit 	Wall-mount Kit 	SFP Dust Cap x 2 (IGS-1820TF only) 

If any of these are missing or damaged, please contact your dealer immediately; if possible, retain the carton including the original packing material, and use them again to repack the product in case there is a need to return it to us for repair.

- 1 -

2.2 LED Definition:

> System

LED	Color	Function	
P1	Green	Lights	Lights to indicate power input 1 has power.
P2	Green	Lights	Lights to indicate power input 2 has power.
Fault	Red	Lights	Lights to indicate that AC or DC power has failed.

> Per 10/100/1000BASE-T Port

LED	Color	Function	
1000 LNK/ACT	Green	Lights	To indicate the link through that port is successfully established at 1000Mbps.
		Blinks	To indicate that the switch is actively sending or receiving data over that port.
10/100 LNK/ACT	Amber	Lights	To indicate the port is successfully established at 10/100Mbps.
		Blinks	To indicate that the Switch is actively sending or receiving data over that port.

- 3 -


2.4 Wiring the Power Inputs

The 6-contact terminal block connector on the top panel of Industrial Ethernet Switch is used for two redundant power inputs. Please follow the steps below to insert the power wire.



When performing any of the procedures like inserting the wires or tightening the wire-clamp screws, make sure the power is OFF to prevent from getting an electric shock.


Insert positive and negative DC power wires into contacts 1 and 2 for POWER 1, or contacts 5 and 6 for POWER 2.

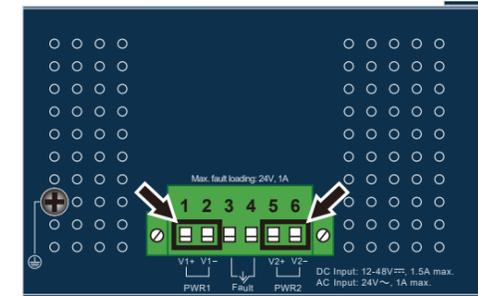

- 5 -

2.5 Wiring the Fault Alarm Contact

The fault alarm contacts are in the middle of the terminal block connector as the picture shows below. Inserting the wires, the Industrial Ethernet Switch will detect the fault status of the power failure, and then forms an open circuit. The following illustration shows an application example for wiring the fault alarm contacts.

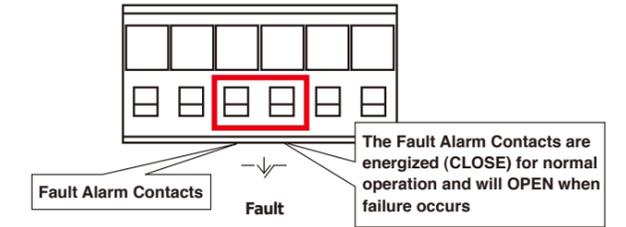

Insert the wires into the fault alarm contacts



- The wire gauge for the terminal block should be in the range between 12 and 24 AWG.
- Alarm relay circuit accepts up to 24V, max. 1A currents.

- 7 -

2. Hardware Introduction

2.1 Switch Front Panel

The front panel of the **Industrial Ethernet Switch** consists of Ethernet interfaces and LED indicators.

■ Front View

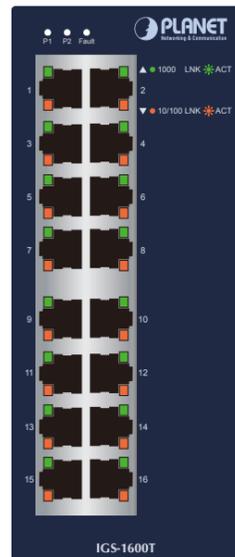


Figure 1:
IGS-1600T Front View

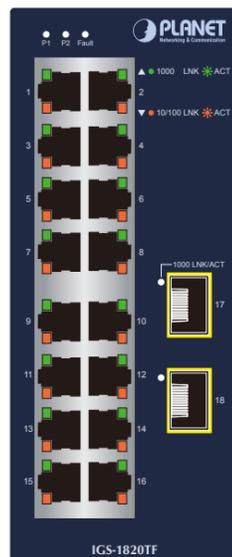


Figure 2:
IGS-1820TF Front View

- 2 -

> Per 1000BASE-X SFP Port (Port-17 and Port-18 of IGS-1820TF)

LED	Color	Function	
LNK/ACT	Green	Lights	To indicate the port is successfully established at 1000Mbps.
		Blinks	To indicate that the Switch is actively sending or receiving data over that port.

2.3 Switch Upper Panel

The upper panel of the Industrial Ethernet Switch consists of one terminal block connector within two power input and one relay output.


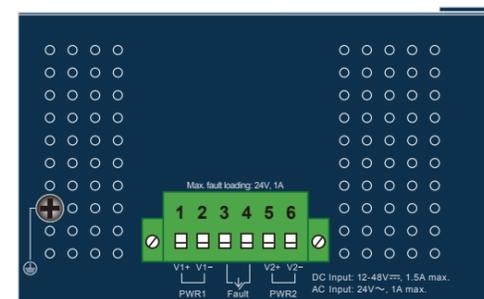


Figure 3: IGS-1600T and IGS-1820TF Top View

- 4 -

Tighten the wire-clamp screws for preventing the wires from loosening.

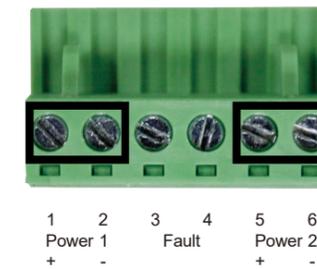


- The wire gauge for the terminal block should be in the range between 12 and 24 AWG.
- The power input range is DC 12V ~ 48V and supports AC 24V.
- Use one power input when using AC 24V.

- 6 -

2.6 Grounding the Device

Users **MUST** complete grounding wired with the device; otherwise, a sudden lightning could cause fatal damage to the device.

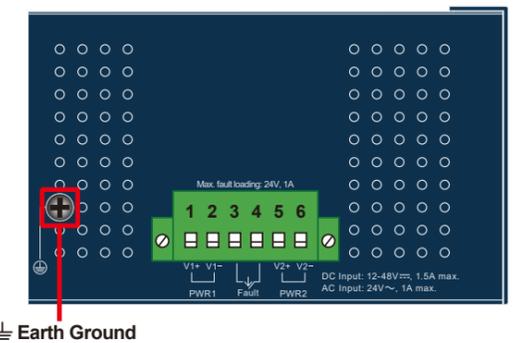

EMD (Lightning) DAMAGE IS NOT COVERED UNDER WARRANTY.

- 8 -

3. Installation

This section describes the functionalities of the Industrial Ethernet Switch's components and guides you to installing it on the DIN rail and wall. Please read this chapter completely before continuing.



This following pictures show how to install the device. However, the device in the picture is not IGS-1600T or IGS-1820TF.

3.1 DIN-rail Mounting Installation



3.2 Wall-mount Plate Mounting



- 9 -

3.3 Side Wall-mount Plate Mounting



4. Product Specifications

Product	IGS-1600T	IGS-1820TF
Hardware Specifications		
Gigabit Ethernet Copper Ports	16 10/100/1000BASE-T RJ45 auto-MDI/MDI-X ports	
Gigabit SFP Slots	--	Two 1000BASE-SX/LX/BX SFP interfaces
Switch Architecture	Store-and-Forward	
Switch Fabric	32Gbps (non-blocking)	36Gbps (non-blocking)
Throughput (packet per second)	23.81Mpps@ 64 bytes	26.79Mpps@ 64 bytes
Address Table	8K entries, automatic source address learning and aging	
Shared Data Buffer	4.1Mbits	

- 10 -

Flow Control	IEEE 802.3x pause frame for full duplex Back pressure for half duplex	
ESD Protection	6KV DC	
Enclosure	IP30 metal case	
Installation	DIN-rail kit and wall-mount kit	
Connector	Removable 6-pin terminal block for power input Pin 1/2 for Power 1, Pin 3/4 for fault alarm, Pin 5/6 for Power 2	
Alarm	One relay output for power failure. Alarm relay current carry ability: 1A @ 24V DC	
Dimensions (W x D x H)	66 x 107 x 152 mm	66 x 107 x 152 mm
Weight	743g	745g
Power Requirements	Dual DC 12~48V, AC 24V	
Power Consumption	DC input: Max. 3.4 watts/ 11.6BTU (System on) Max. 8.7 watts/ 29.7BTU (Full loading)	DC input: Max. 3.4 watts/ 11.6BTU (System on) Max. 11.1 watts/ 37.9BTU (Full loading)
	AC input: Max. 5 watts/17BTU (System on) Max. 13.99 watts/ 47.8BTU (Full loading)	AC input: Max. 6 watts/20.5BTU (System on) Max. 15 watts/51.2BTU (Full loading)

- 11 -

Standards Conformance		
Regulatory Compliance	FCC Part 15 Class A, CE	
Stability Testing	IEC60068-2-32 (free fall) IEC60068-2-27 (shock) IEC60068-2-6 (vibration)	
Standards Compliance	IEEE 802.3 10BASE-T IEEE 802.3u 100BASE-TX IEEE 802.3ab 1000BASE-T IEEE 802.3x flow control and back pressure IEEE 802.1p Class of Service IEEE 802.3az Energy Efficient Ethernet (EEE)	IEEE 802.3 10BASE-T IEEE 802.3u 100BASE-TX IEEE 802.3ab 1000BASE-T IEEE 802.3z 1000BASE-SX/LX IEEE 802.3x flow control and back pressure IEEE 802.1p Class of Service IEEE 802.3az Energy Efficient Ethernet (EEE)
	Environment	
Operating Temperature	-40 ~ 75 degrees C	
Storage Temperature	-40 ~ 85 degrees C	
Humidity	5 ~ 95% (non-condensing)	

- 12 -



User's Manual

www.PLANET.com.tw

Industrial Multi-Port 10/100/1000T Gigabit Ethernet Switch

IGS-1600T/IGS-1820TF



PLANET Technology Corp.

10F., No. 96, Minquan Rd., Xindian Dist., New Taipei City 231, Taiwan

Warning:
This equipment is compliant with Class A of CISPR 32.
In a residential environment this equipment may cause radio interference.
2350-AH7020-000



5. Customer Support

Thank you for purchasing PLANET products. You can browse our online FAQ resource on PLANET web site first to check if it could solve your issue. If you need more support information, please contact PLANET switch support team.

PLANET online FAQs:
<http://www.planet.com.tw/en/support/faq>

Switch support team mail address:
support@planet.com.tw

Copyright © PLANET Technology Corp. 2019.
Contents are subject to revision without prior notice.
PLANET is a registered trademark of PLANET Technology Corp.
All other trademarks belong to their respective owners.

- 13 -

FCC Warning

This equipment has been tested and found to comply with the regulations for a Class A digital device, pursuant to Part 15 of the FCC Rules. These limits are designed to provide reasonable protection against harmful interference when the equipment is operated in a commercial environment. This equipment generates, uses, and can radiate radio frequency energy and, if not installed and used in accordance with this user's guide, may cause harmful interference to radio communications. Operation of this equipment in a residential area is likely to cause harmful interference, in which case the user will be required to correct the interference at his own expense.

CE Mark Warning

This device is compliant with Class A of CISPR 32. In a residential environment this equipment may cause radio interference.

WEEE Warning

 To avoid the potential effects on the environment and human health as a result of the presence of hazardous substances in electrical and electronic equipment, end users of electrical and electronic equipment should understand the meaning of the crossed-out wheeled bin symbol. Do not dispose of WEEE as unsorted municipal waste and have to collect such WEEE separately.

- 14 -